



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)  
BOARD AND CODE ADMINISTRATION DIVISION  
**NOTICE OF ACCEPTANCE (NOA)**

MIAMI-DADE COUNTY  
PRODUCT CONTROL SECTION  
11805 SW 26 Street, Room 208  
T (786) 315-2590 F (786) 315-2599  
[www.miamidade.gov/economy](http://www.miamidade.gov/economy)

F.P.G. Wholesale, Inc.  
7190 Coral Way  
Miami, FL 33155

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/ or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Series "Condoor" 8'-0" Outswing Glazed Wood French Door w/wo Sidelites - N.I.**

**APPROVAL DOCUMENT:** Drawing No. W08-35, Series titled "Out-Swing Wood Patio Door (N.I.)", sheets 1 through 8 of 8, dated 04/04/08, with revision D dated 09/16/15, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

**MISSILE IMPACT RATING: None.**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/ or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA No. 13-0510.02 and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by Manuel Perez, P.E.



*MP*  
10/01/15

NOA No. 15-0615.05  
Expiration Date: June 19, 2018  
Approval Date: October 08, 2015  
Page 1

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.  
*(Submitted under NOA No. 08-0422.08)*
2. Drawing No. **W08-35**, titled "Out-Swing Wood Patio Door (N.I.)", sheets 1 through 8 of 8, dated 04/04/08, with revision **D** dated 09/16/15, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E.

**B. TESTS**

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94  
along with marked-up drawings and installation diagram of an outswing French door, prepared by Hurricane Engineering and Testing, Inc., Test Reports No. **HETI-07-4174**, **HETI-07-4175** and **HETI-07-4176**, dated 11/15/07, all signed and sealed by Candido F. Font, P.E.  
*(Submitted under NOA No. 08-0422.08)*

**C. CALCULATIONS**

1. Anchor verification calculations and structural analysis, complying with **FBC 5<sup>th</sup> Edition (2014)**, dated 06/03/15, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E.
2. Glazing complies with **ASTM E1300-09**

**D. QUALITY ASSURANCE**

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

**E. MATERIAL CERTIFICATIONS**

1. National Casing data-/ specification sheet of National Casing WUP 4379 Adhesive.
2. National Casein data-/ specification sheet of National Casein 5881 Adhesive.



Manuel Perez, P.E.

Product Control Examiner

NOA No. 15-0615.05

Expiration Date: June 19, 2018

Approval Date: October 08, 2015

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

**F. STATEMENTS**



1. Statement letter of conformance, complying with **FBC 5<sup>th</sup> Edition (2014)**, and of no financial interest, dated 05/26/15, issued by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E.
2. Laboratory compliance letters for Test Reports No. **HETI-07-4174, HETI-07-4175** and **HETI-07-4176**, issued by Hurricane Engineering and Testing, Inc., dated 11/15/07, signed and sealed by Candido F. Font, P.E.  
*(Submitted under NOA No. 08-0422.08)*

**G. OTHERS**

1. Notice of Acceptance No. **13-0510.02**, issued to F.P.G. Wholesale, Inc. for their Series "Condoor" 8'0" Outswing Glazed Wood Door with & without Sidelites - N.I., approved on 07/18/13 and expiring on 06/19/18.

  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No. 15-0615.05

Expiration Date: June 19, 2018  
Approval Date: October 08, 2015

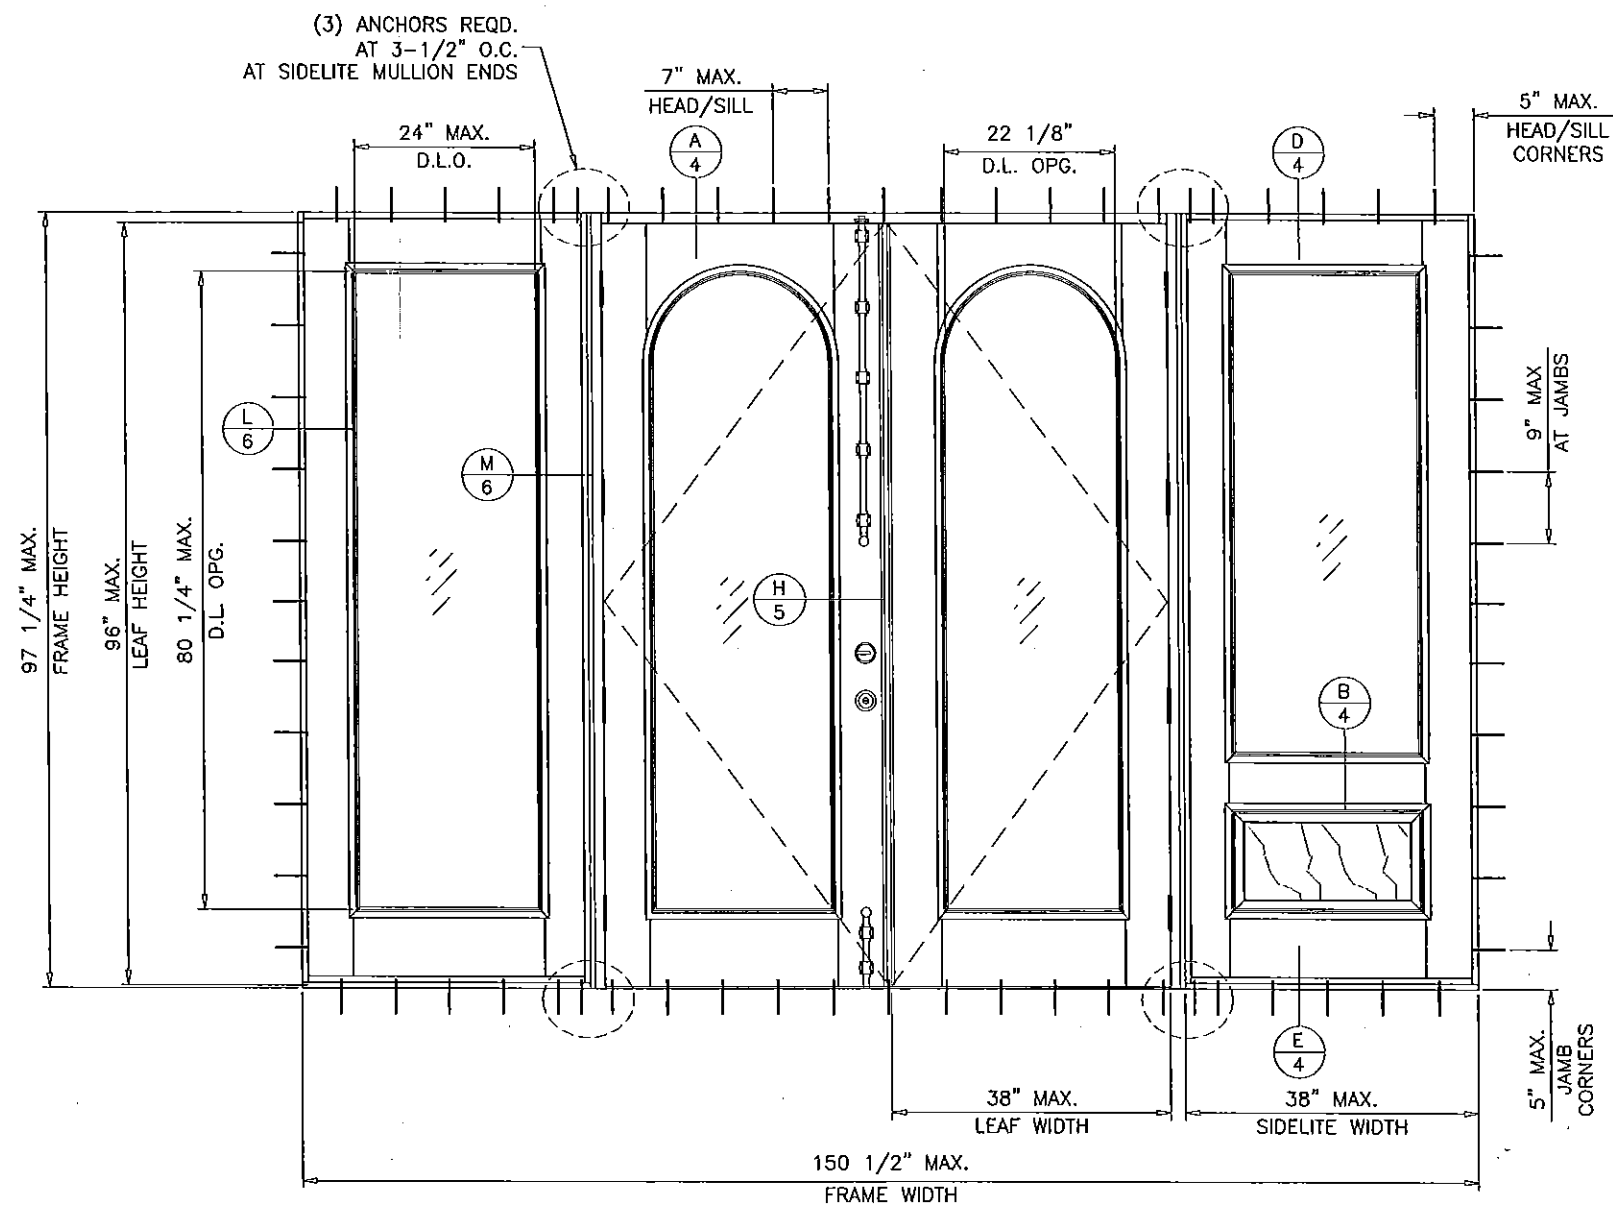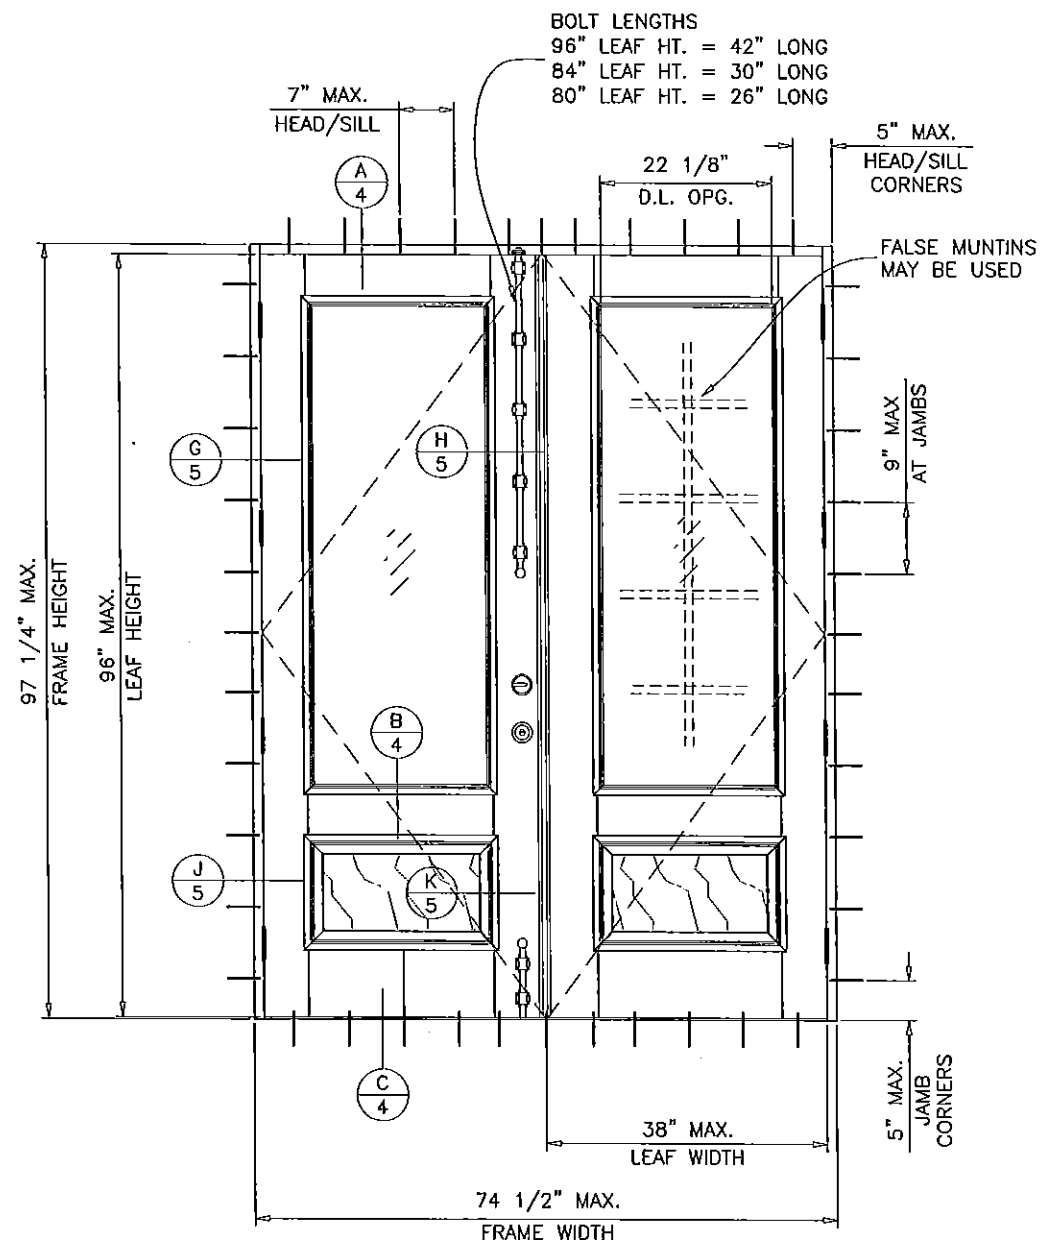

TYPICAL ELEVATIONS

# OUT-SWING WOOD PATIO DOOR

APPROVAL APPLIES TO SINGLE (X) AND DOUBLE (XX) LEAF DOORS WITH OR WITHOUT SIDELITES.  
SIDE LITES CAN BE ON ONE SIDE OR BOTH SIDES OF DOOR.  
SEE SHEET 2 FOR DESIGN LOAD CAPACITY.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE.

## PRODUCT REVISED

as complying with the Florida

Building Code

Acceptance No

Expiration Date

By

Miami Made Product Control

15-0615.05  
06/19/2018

DOORS/SIDELITES NOT RATED FOR IMPACT.

INSTALLATION OF THIS PRODUCT IN THE HVHZ AREA REQUIRES THE USE OF APPROVED SHUTTERS OR EXTERNAL PROTECTION DEVICES COMPLYING WITH HVHZ REQUIREMENTS.

INSTALLATION OF THIS SYSTEM OUTSIDE THE HVHZ AREA SHALL MEET THE APPLICABLE REQUIREMENTS FOR WIND BORNE DEBRIS PROTECTION.

THE APPROVED PRODUCTS NOTED HEREIN ARE EXEMPT FROM PRESERVATIVE TREATMENT PER FLORIDA BUILDING CODE WHICH EXEMPTS WOOD SPECIES LISTED AS 'DURABLE'.  
THE SPECIFIC PRODUCTS HEREIN ARE EXEMPTED WOOD SPECIES BASED ON USDA LISTING AND MUST HAVE A SPECIFIC GRAVITY EQUAL TO OR HIGHER THAN THE REFERENCED SPECIES.

Engr: JAVAD AHMAD  
CIVIL  
FLA. PE # 70592  
C.A.N. # 5538

SEP 23 2015

INSULATING GLASS  
MONOLITHIC GLASS  
SOLID WOOD INSERTS  
NON IMPACT

**af c**  
**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX (305) 262-6978  
COMP-ANL\W08-35FPG

OUT-SWING WOOD PATIO DOOR (N.I.)  
**F.P.G. WHOLESALE INC.**  
7190 CORAL WAY  
MIAMI, FLORIDA 33155  
TEL (305) 266-2296 FAX (305) 261-6540


revisions:	no	date	by	description
	A	05.16.08		REV. PER BCCO COMMENTS
	B	04.27.12		UPDATED TO 2010 FBC
	C	05.29.15		UPDATED TO 2014 FBC
	D	09.16.15		NO CHANGE THIS SHEET

date: 04-04-08  
scale: 1/2"=1'-0"  
dr. by: HAMID  
chk. by:


drawing no.  
**W08-35**

sheet 1 of 8

SINGLE LEAF (X) OR DOUBLE LEAF (XX) DOORS			
DESIGN LOAD CAPACITY - PSF			
LEAF WIDTH FT./IN.	LEAF HEIGHT FT./IN.	GLAZING TYPES 'B', 'C', 'D' OR 'E'	
		EXT. (+)	INT. (-)
2/0	6/8	60.0	72.9
2/6		60.0	72.9
3/0		60.0	72.9
3/2		60.0	72.9
2/0	7/0	60.0	69.5
2/6		60.0	69.5
3/0		60.0	69.5
3/2		60.0	69.5
2/0	8/0	60.0	60.0
2/6		60.0	60.0
3/0		60.0	60.0
3/2		60.0	60.0

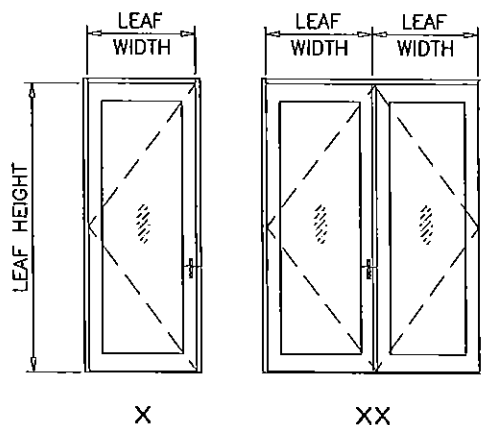


STATIONARY PANEL (O) OR DOORS WITH SIDELITES			
DESIGN LOAD CAPACITY - PSF			
WIDTH (W) INCHES	LEAF HEIGHT FT./IN.	GLAZING TYPES 'B', 'C', 'D' OR 'E'	
		EXT. (+)	INT. (-)
2/0	6/8	60.0	72.9
2/6		60.0	72.9
3/0		60.0	72.9
3/2		60.0	72.9
2/0	7/0	60.0	69.5
2/6		60.0	69.5
3/0		60.0	69.5
3/2		60.0	69.5
2/0	8/0	60.0	60.0
2/6		60.0	60.0
3/0		60.0	60.0
3/2		60.0	60.0

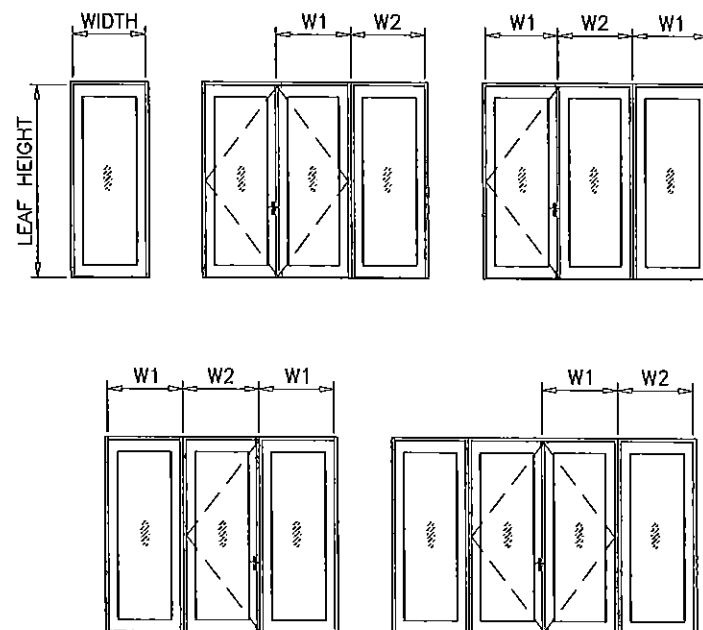


$$\text{WIDTH (W)} = \frac{W1 + W2}{2}$$

(FOR DOORS WITH SIDELITES)


NOTE:  
GLASS CAPACITIES ARE  
BASED ON ASTM E1300-09 (3 SEC. GUSTS)  
AND FLORIDA BUILDING COMMISSION  
DECLARATORY STATEMENT DCA05-DEC-219

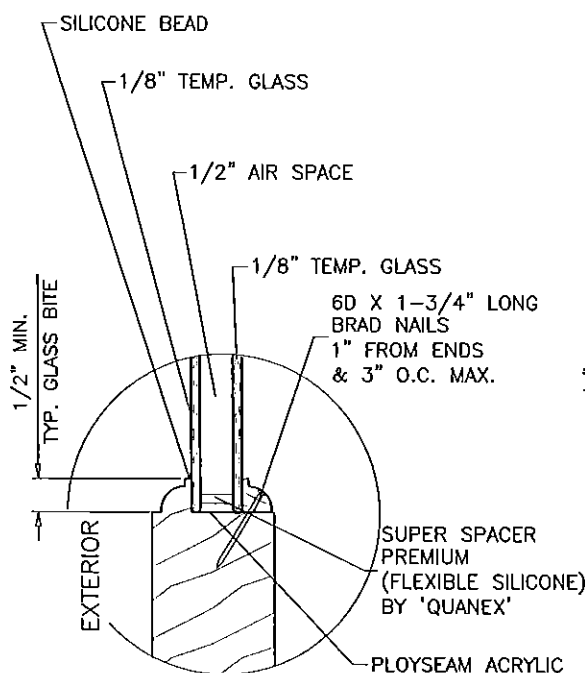


**GLAZING TYPE 'B'**  
3/4" THICKNESS NOMINAL

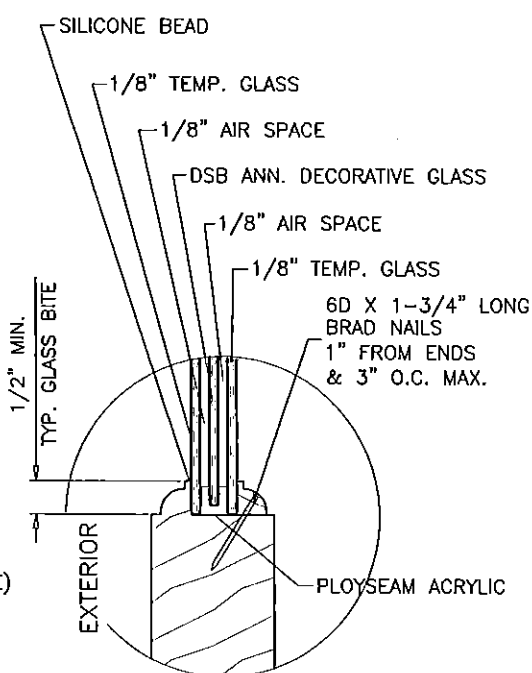

**GLAZING TYPE 'C'**  
11/16" THICKNESS NOMINAL

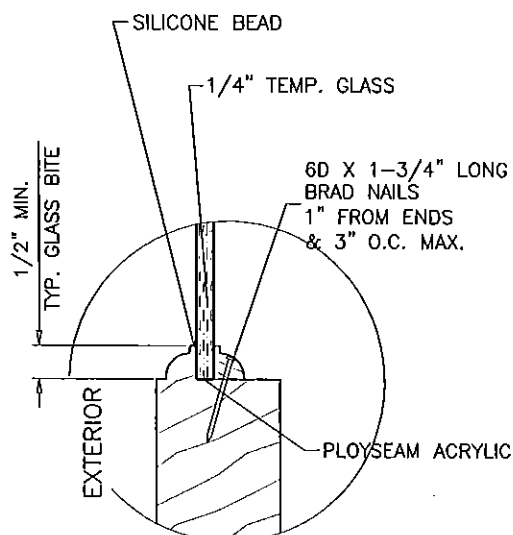

**GLAZING TYPE 'D'**  
11/16" THICKNESS NOMINAL

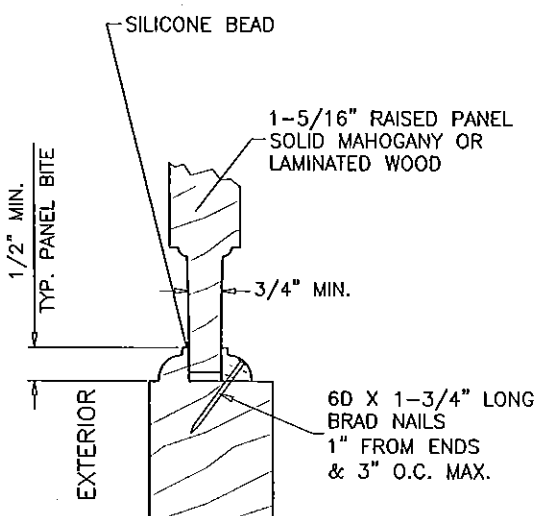

**GLAZING TYPE 'E'**  
11/16" THICKNESS NOMINAL

BRAD NAILS TO COMPLY WITH ASTM F 1667-13

### GLAZING OPTIONS

MAX. AREA OF GLASS INSERTS.....13.4 SQ. FT.  
MAX. AREA OF WOOD INSERTS.....8.5 SQ. FT.

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 15-0615.06  
Expiration Date 06/29/2018  
By *Manuel*  
Miami Dade Product Control

Engr: JAVAD AHMAD  
CIVIL  
FLA. PE # 70592  
C.A.N. 3538  
SEP 23 2015

**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL (305) 262-6978 FAX (305) 262-6978  
COMP-ANL\W08-35FPG

OUT-SWING WOOD PATIO DOOR (N.I.)

**F.P.G. WHOLESALE INC.**  
7190 CORAL WAY  
MIAMI, FLORIDA 33155  
TEL (305) 266-2296 FAX (305) 261-6540

revisions:

no	date	by	description
A	05.16.08	REV. PER BCCO COMMENTS	
B	04.27.12	UPDATED TO 2010 FBC	
C	05.29.15	UPDATED TO 2014 FBC	
D	09.16.15	REV. PER PER COMMENTS	

date: 04-04-08


scale: -

dr. by: HAMID

chk. by:

drawing no.  
**W08-35**

sheet 2 of 8

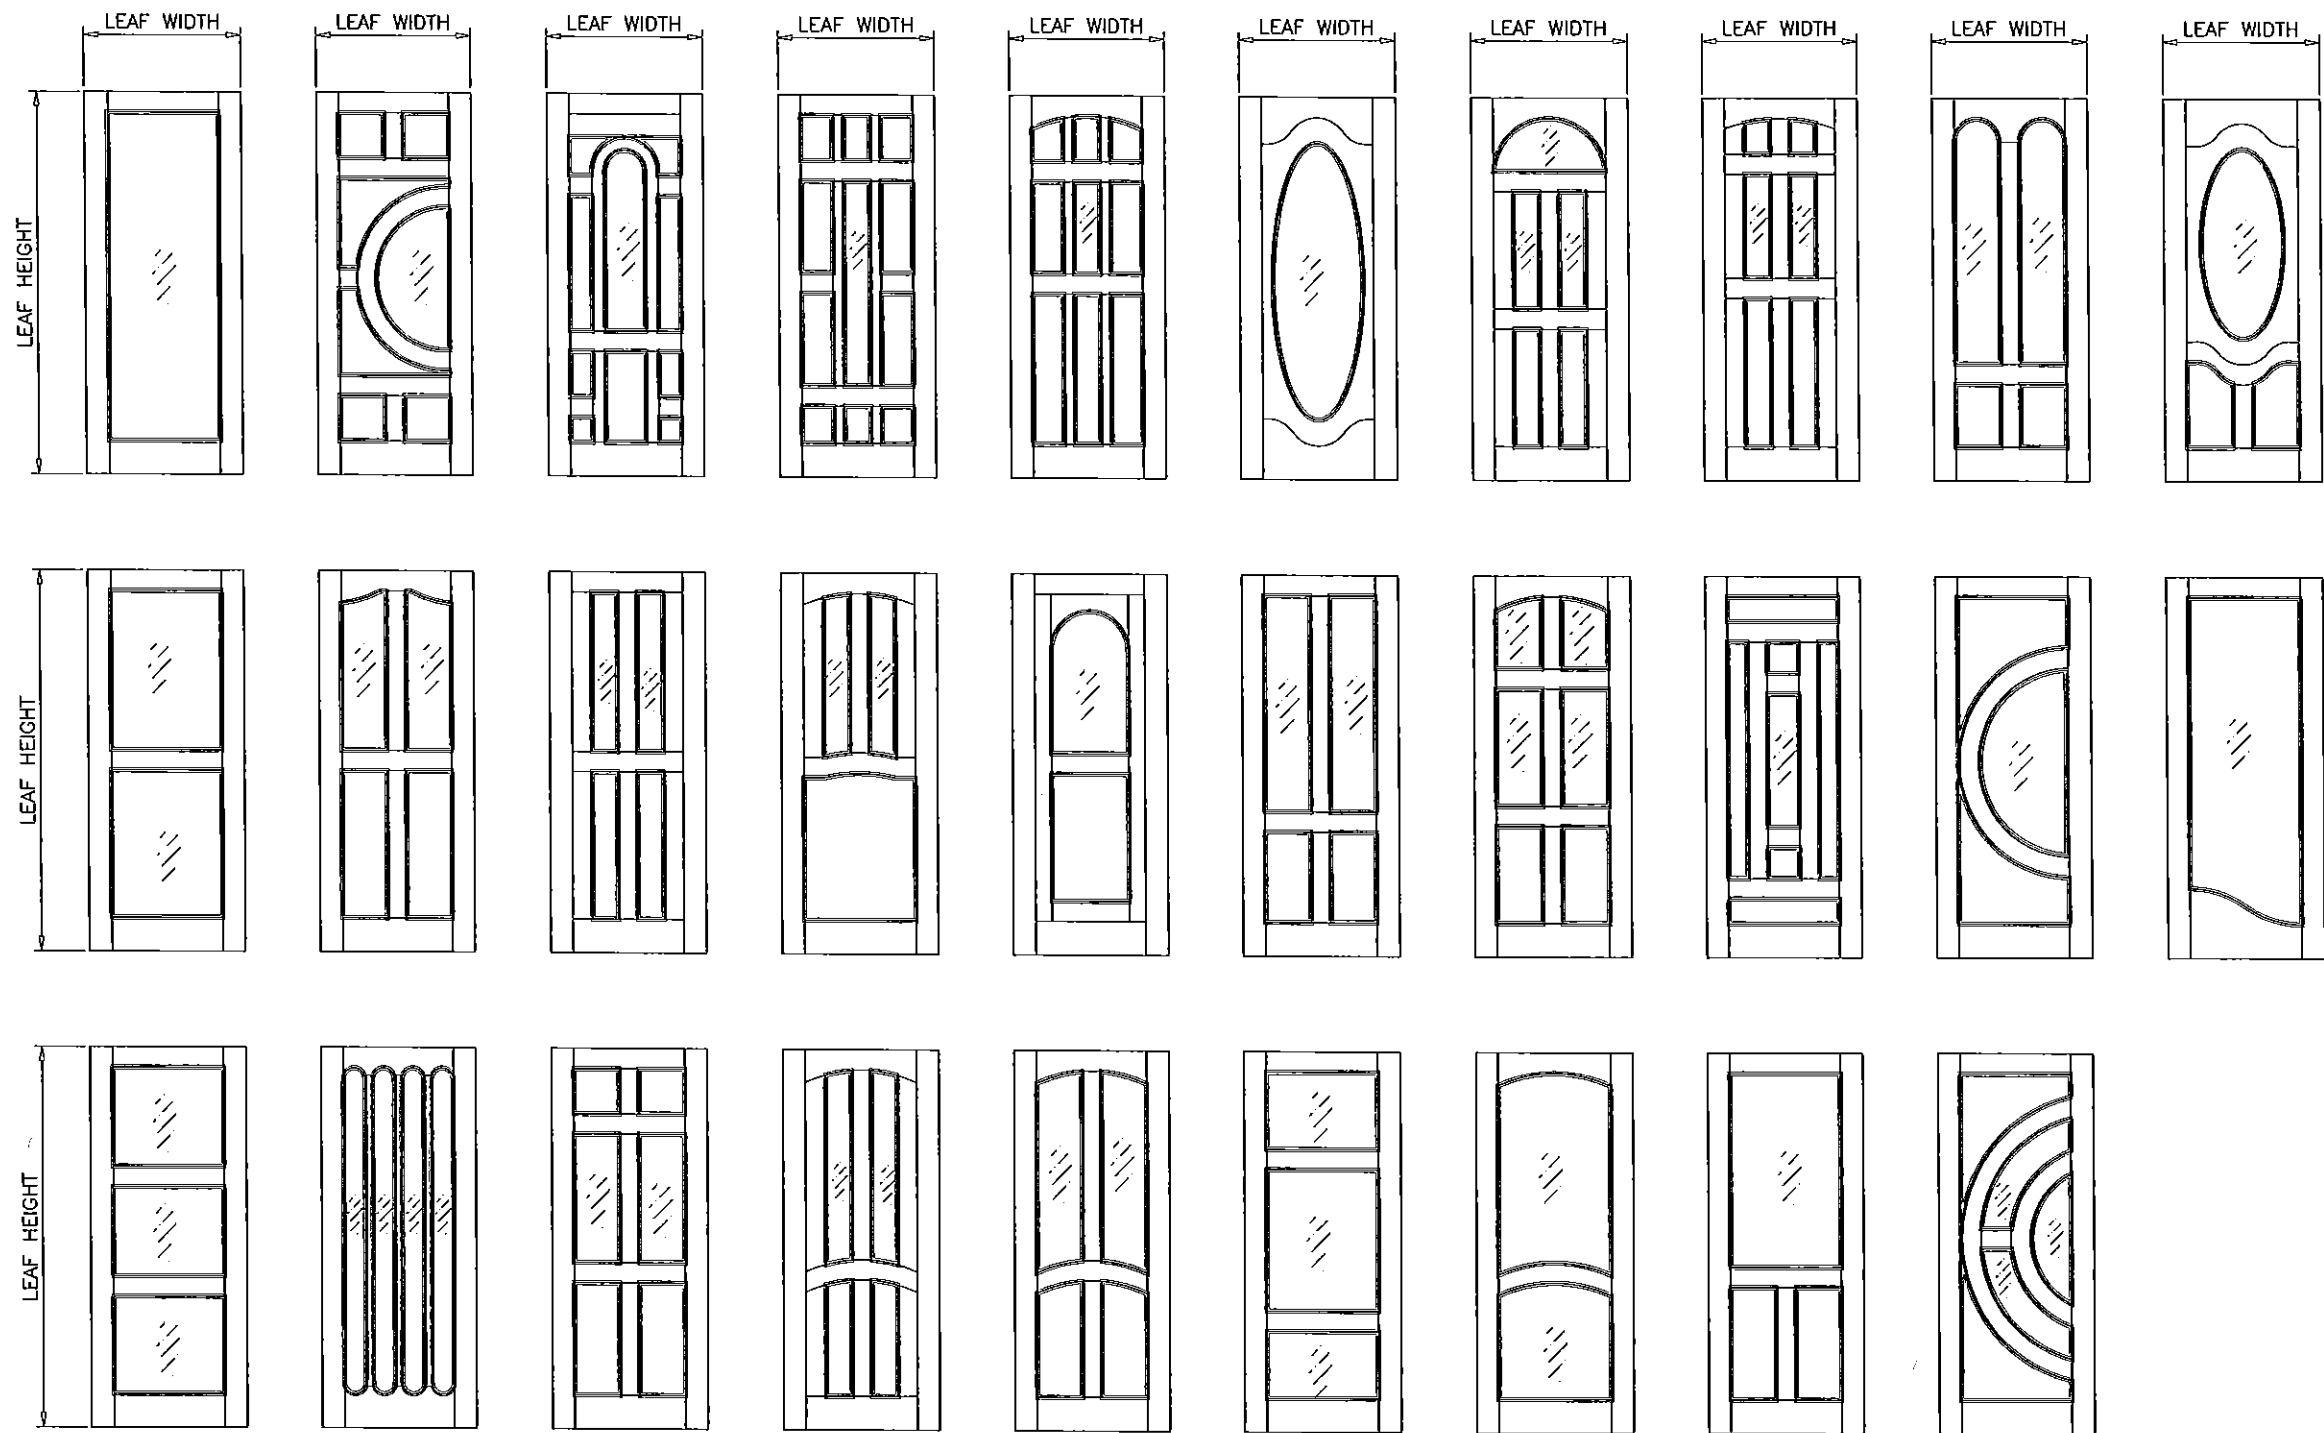

LEAF PATTERNS AS SHOWN ABOVE OR SIMILAR WITH VARIUOS FINISHES  
AND DECORATIVE MOULDINGS GLAZED WITH GLASS OR SOLID WOOD INSERTS  
ARE ALSO ALLOWED.

MINIMUM DIMENSIONS:

STILES AND TOP RAIL.....6-3/4"  
LOCK STILES.....6-3/4"  
INTERMEDIATE RAILS.....8-1/2"  
INTERMEDIATE STILES.....3-1/2"  
BOTTOM RAILS.....9-1/2"

LIMIT MAX. AREA OF GLASS INSERTS.....13.4 SQ. FT.  
LIMIT MAX. AREA OF WOOD INSERTS.....8.5 SQ. FT.

SEE SHEET 2 FOR DESIGN LOAD CAPACITY.

PRODUCT REVISED

as complying with the Florida  
Building Code  
Acceptance No. 15-0615.05  
Expiration Date 06/15/2018

By *Manuel*  
Miami Dade Product Control

Engr: JAVAD AHMAD  
CIVIL  
FLA. PE # 70592  
C.A.N. 3538

SEP 23 2015

**af c**  
**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
COMP-ANL\W08-35FPG

OUT-SWING WOOD PATIO DOOR (N.I.)

**F.P.G. WHOLESALE INC.**


7190 CORAL WAY  
MIAMI, FLORIDA 33155  
TEL. (305) 266-2296 FAX (305) 261-6540

revisions:	no	date	by	description
	A	05.16.08		REV. PER BCCO COMMENTS
	B	04.27.12		NO CHANGE THIS SHEET
	C	05.29.15		NO CHANGE THIS SHEET
	D	09.16.15		NO CHANGE THIS SHEET


date: 04-04-08	scale: -	dr. by: HAMID	chk. by:
----------------	----------	---------------	----------

drawing no.  
**W08-35**

sheet 3 of 8

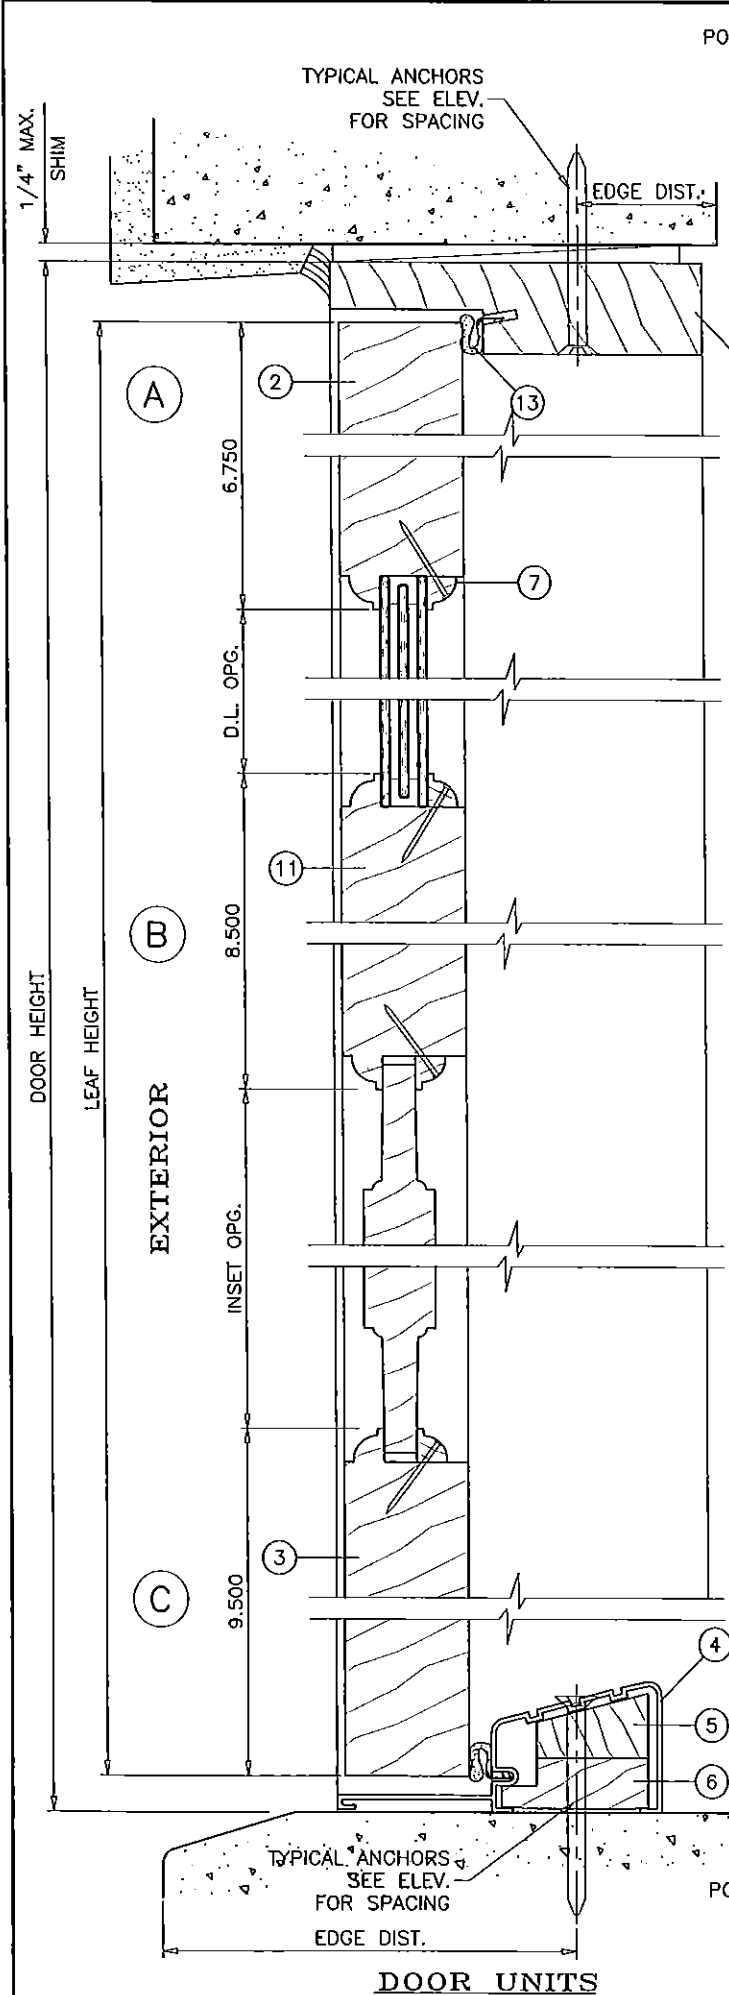

DOOR UNITS

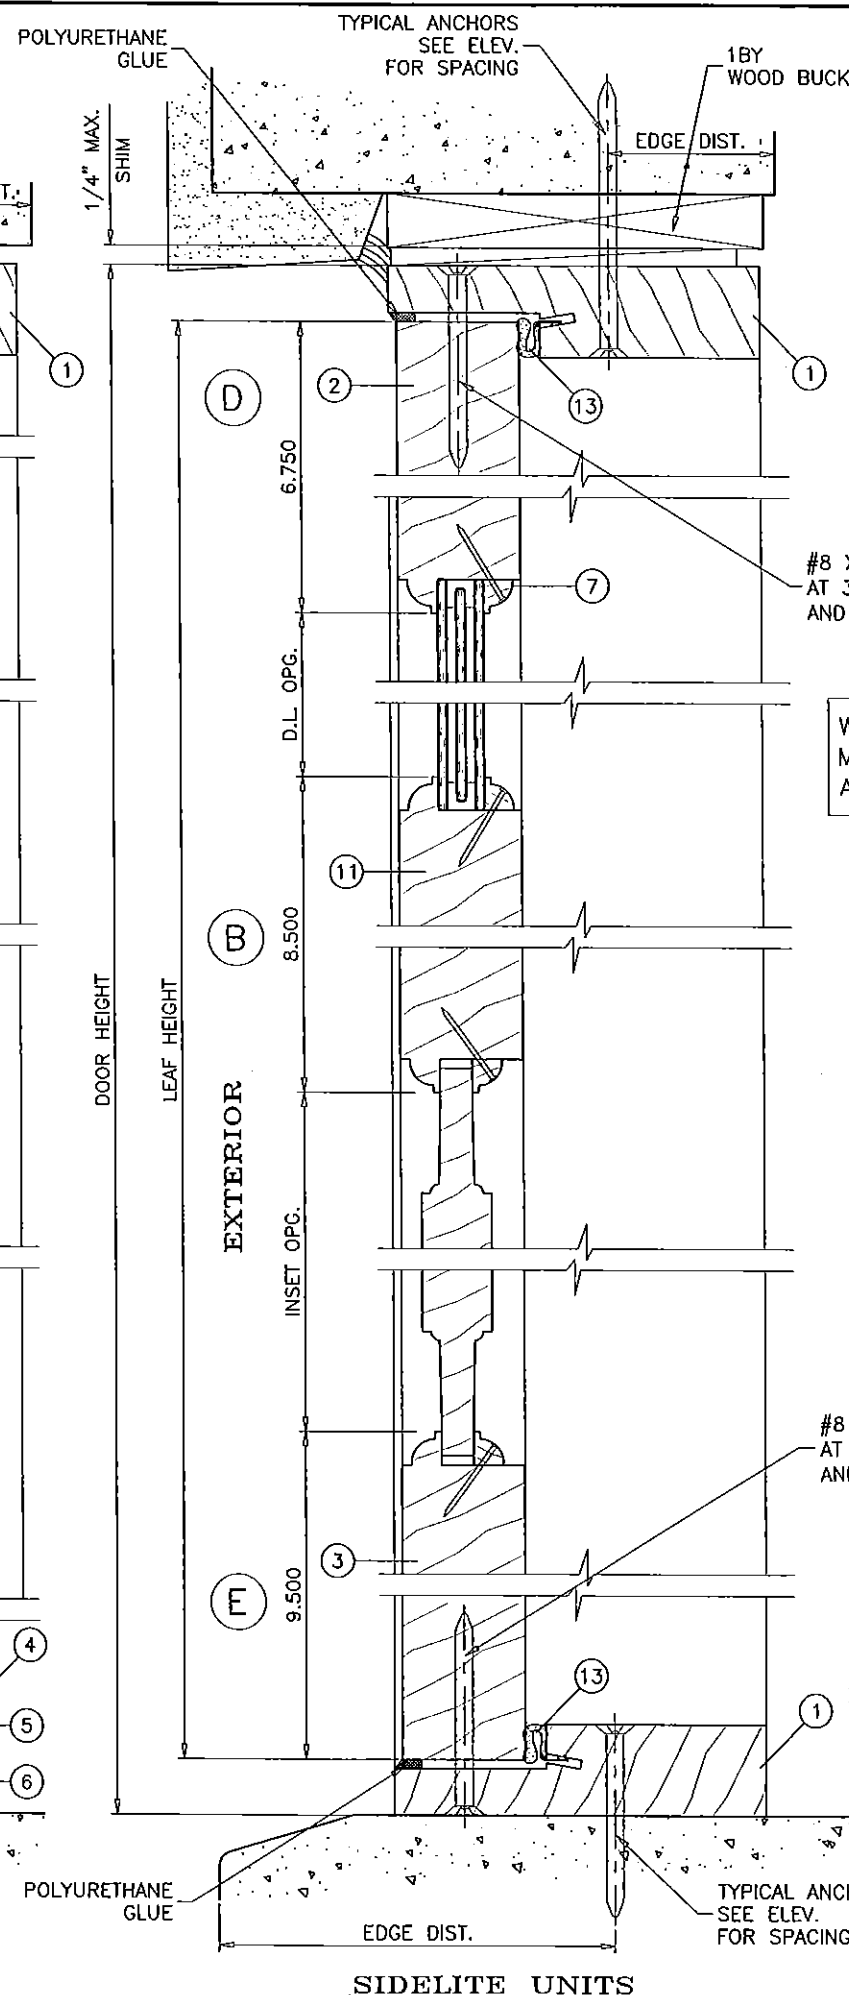

SIDELITE UNITS

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 15-0615.05  
Expiration Date 06/19/2018  
By *Manuel*  
Miami Dade Product Control

WOOD BUCKS AND METAL STRUCTURE NOT BY F.P.G.  
MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM  
AND TRANSFER THEM TO THE BUILDING STRUCTURE.

#### TYPICAL ANCHORS: SEE ELEV. FOR SPACING

1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)

INTO 2BY WOOD BUCKS OR WOOD STRUCTURES  
1-1/2" MIN. PENETRATION INTO WOOD (HEAD/JAMBS)

THRU 1BY BUCKS INTO CONC. OR MASONRY  
1-1/4" MIN. EMBED INTO CONCRETE (HEAD)  
1-1/4" MIN. EMBED INTO CONC. OR MASONRY (JAMBS)

DIRECTLY INTO CONC. OR MASONRY  
1-1/4" MIN. EMBED INTO CONCRETE (HEAD/SILL)  
1-1/4" MIN. EMBED INTO CONC. OR MASONRY (JAMBS)

#### #14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)

INTO MIAMI-DADE COUNTY APPROVED MULLIONS (MIN. THK. = 1/8")

INTO METAL STRUCTURES

STEEL : 1/8" THK. MIN. (Fy = 36 KSI MIN.)

ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)

(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

#### TYPICAL EDGE DISTANCE

INTO CONCRETE AND MASONRY = 1" MIN.

INTO WOOD STRUCTURE = 3/4" MIN.

INTO METAL STRUCTURE = 1/2" MIN.

WOOD AT HEAD OR JAMBS SG = 0.55 MIN.

CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.

C-90 NORMAL WEIGHT HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

Engr: JAVAD AHMAD  
CIVIL  
FLA. PE # 70592  
C.A.N. 3538



SEP 23 2015

**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL (305) 264-8100 FAX (305) 262-6978  
COMP-ANL\W08-35FPG

OUT-SWING WOOD PATIO DOOR (N.I.)  
**F.P.G. WHOLESALE INC.**  
7190 CORAL WAY  
MIAMI, FLORIDA 33155  
TEL (305) 266-2296 FAX (305) 261-6540

revisions:	no	date	by	description
	A	05.16.08	REV. PER BCCO	COMMENTS
	B	04.27.12	UPDATED TO 2010 FBC	
	C	05.29.15	UPDATED TO 2014 FBC	
	D	09.16.15	REV. PER RER COMMENTS	

date: 04-04-08  
scale: 3/8" = 1"  
dr. by: HAMID  
chk. by:  
drawing no.  
**W08-35**  
sheet 4 of 8

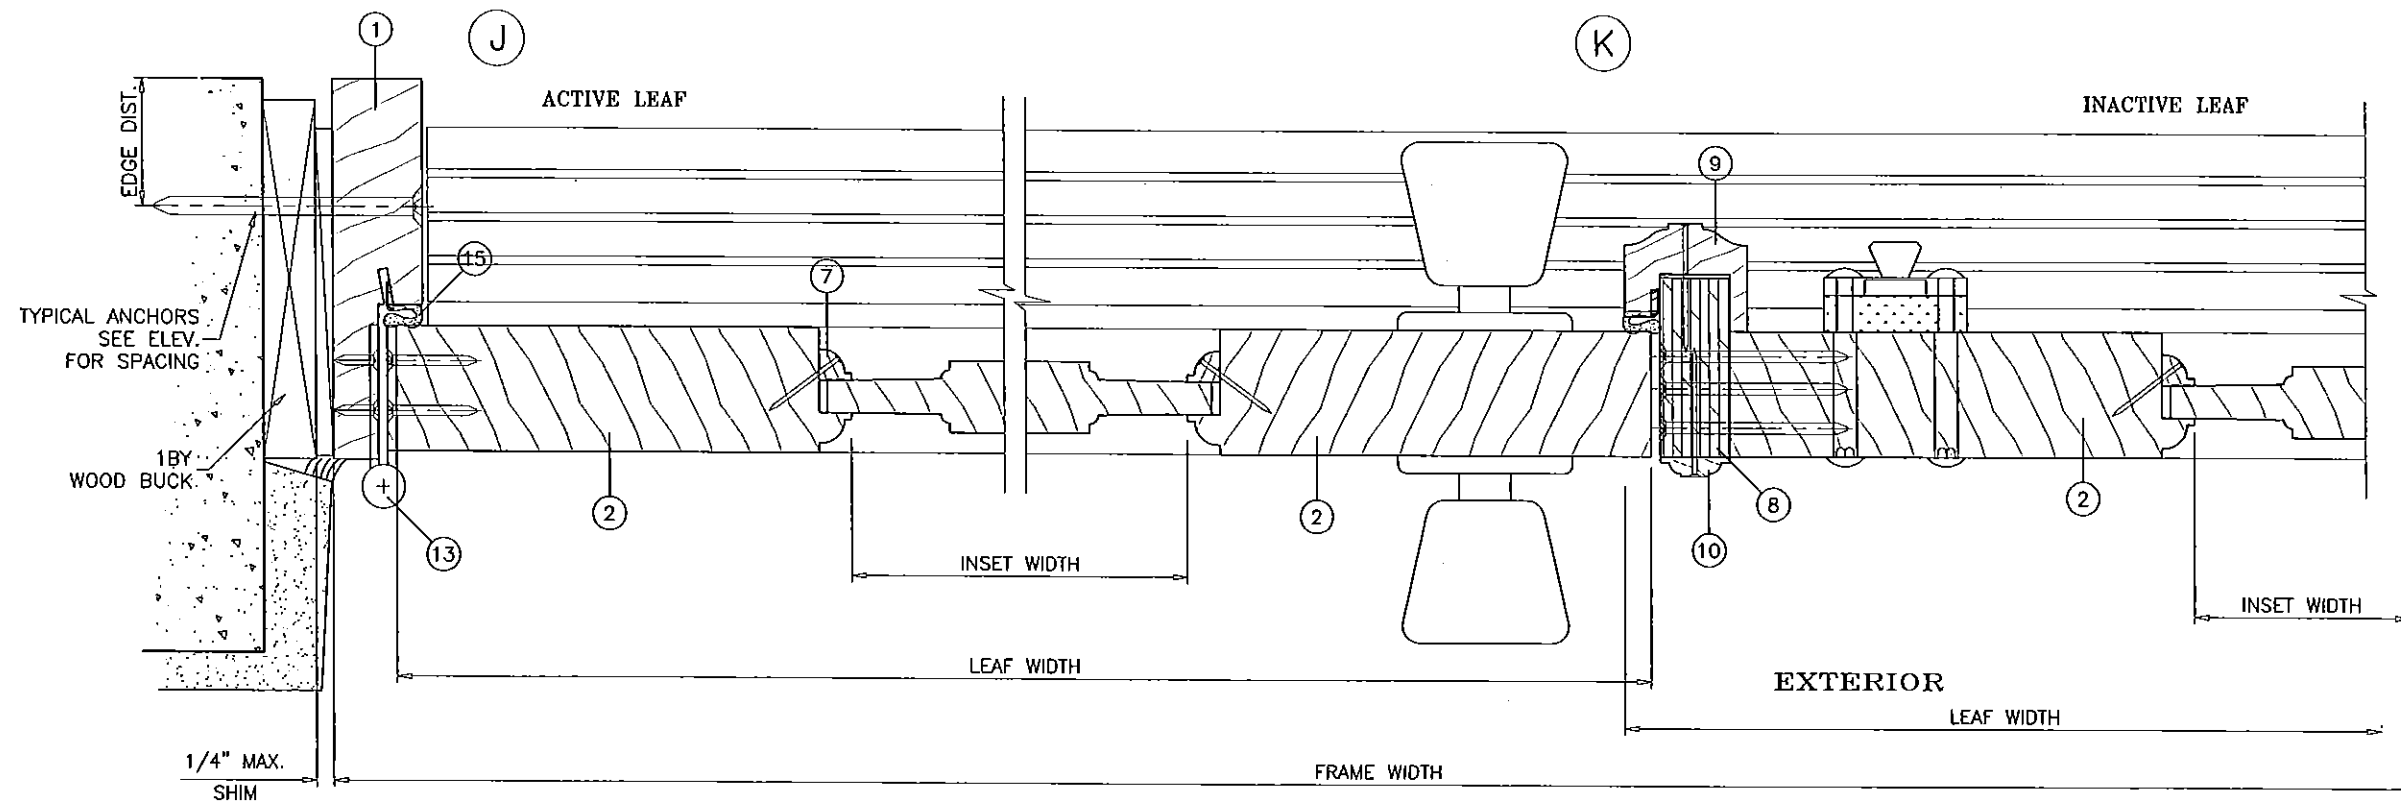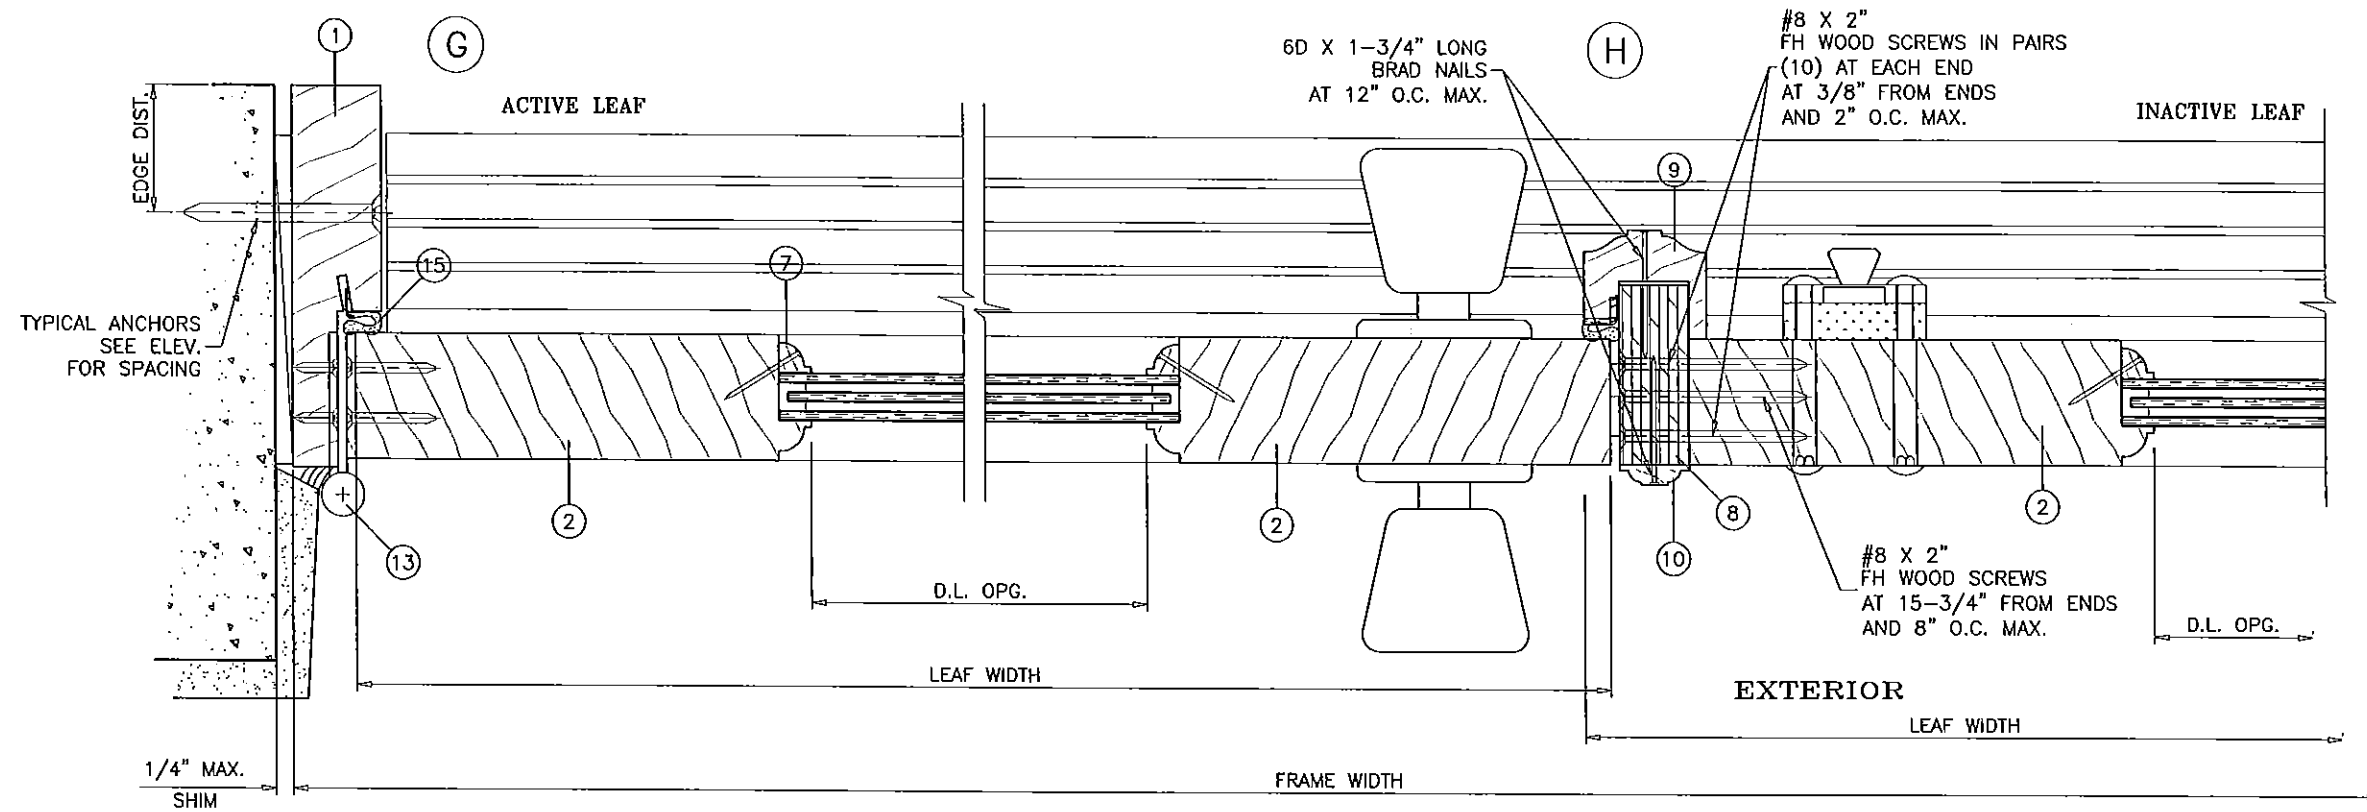

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. **15-0615.05**  
Expiration Date **06/29/2018**  
by **Manuel Perez**  
Miami Dade Product Control

Engr: JAVAD AHMAD  
CIVIL  
FLA. PE # 70592  
C.A.N. 3538

**SEP 23 2015**

**afC**  
**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
COMP - ANL \ W08 - 35FPG



**OUT-SWING WOOD PATIO DOOR (N.I.)**  
**F.P.G. WHOLESALE INC.**  
7190 CORAL WAY  
MIAMI, FLORIDA 33155  
TEL. (305) 266-2286 FAX (305) 261-6540

revisions:	no	date	by	description
	A	05.16.08		REV. PER BCC COMMENTS
	B	04.27.12		NO CHANGE THIS SHEET
	C	05.29.15		UPDATED TO 2014 FBC
	D	09.16.15		NO CHANGE THIS SHEET

date: 04-04-08  
scale: 3/8" = 1"  
dr. by: HAMID  
chk. by:

drawing no.  
**W08-35**  
sheet 5 of 8



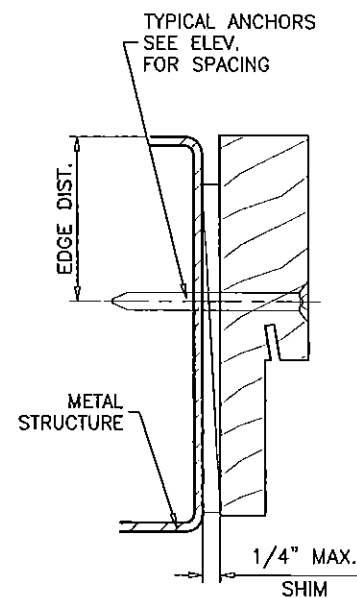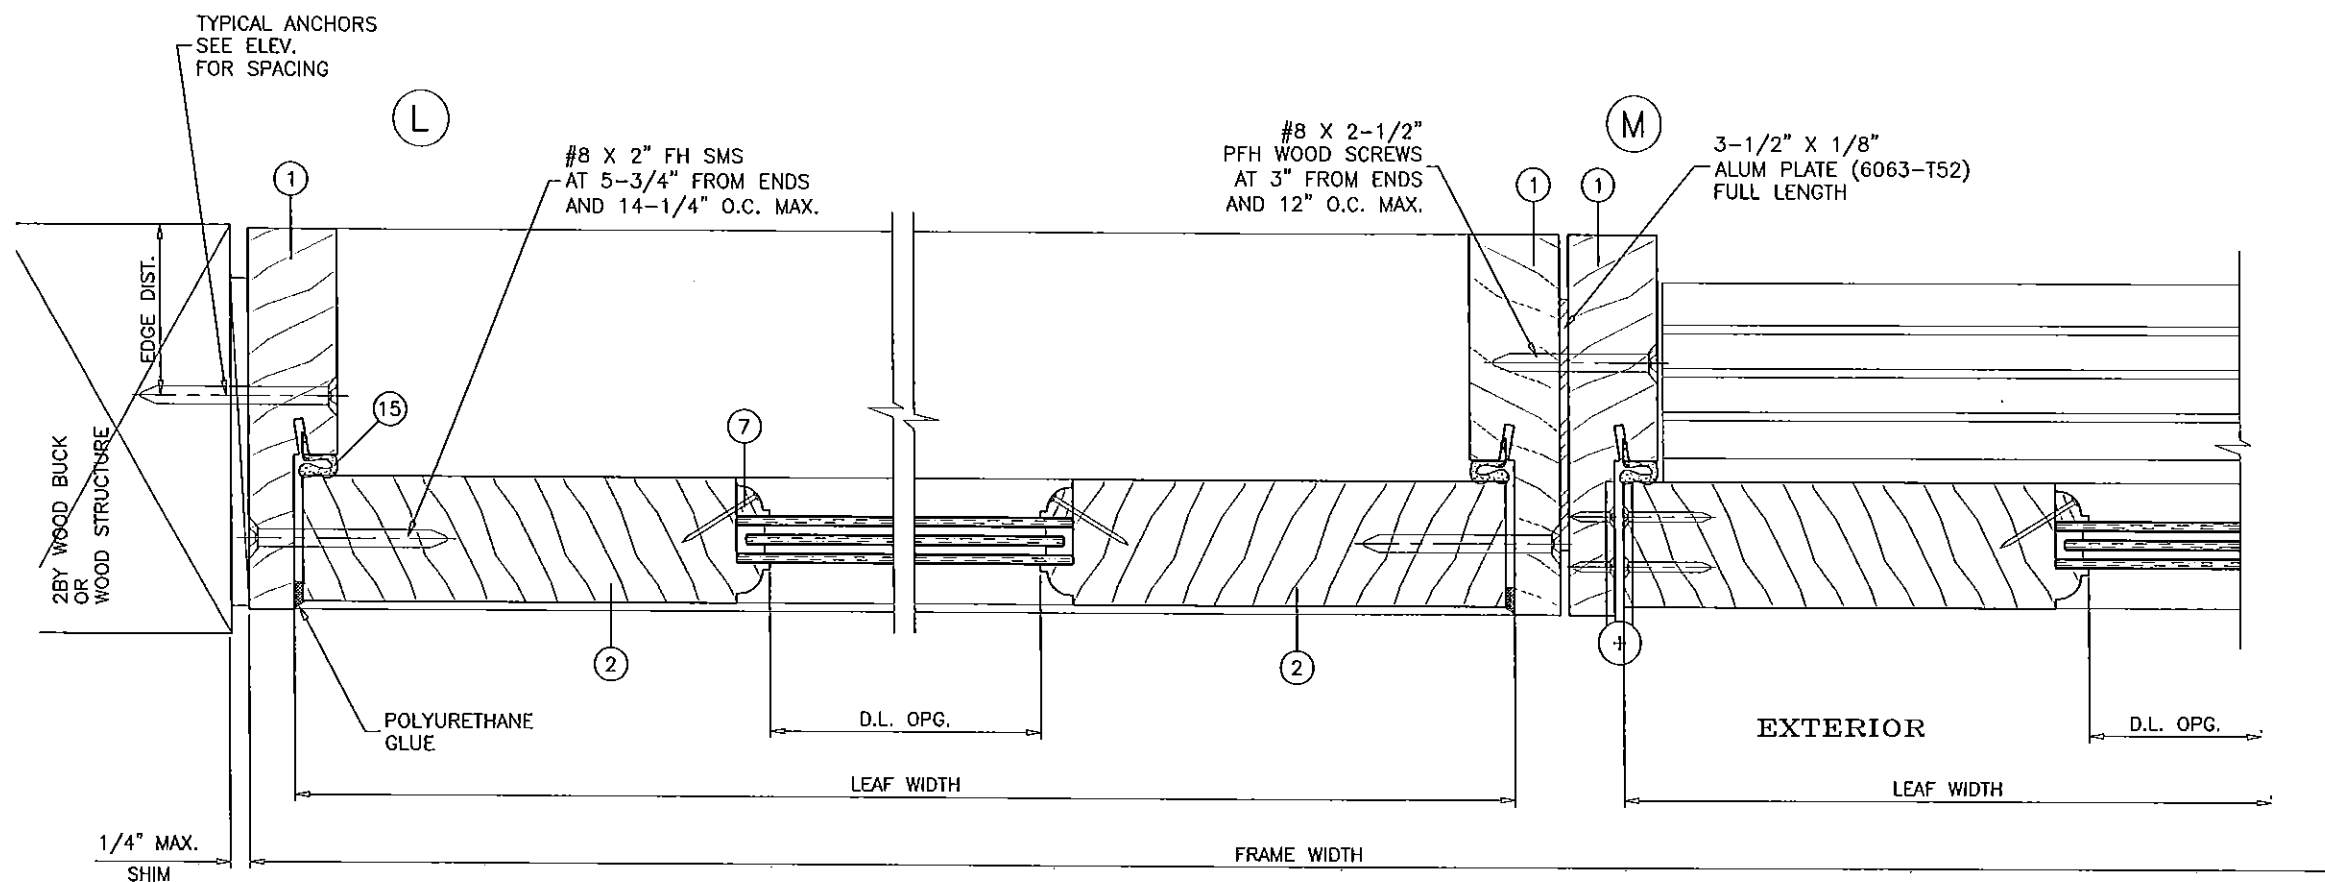

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. **15-0615.05**  
Expiration Date **06/19/2018**  
By *Manuel Perez*  
Miami Dade Product Control

Engr: JAVAD AHMAD  
CIVIL  
FLA. PE # 70592  
C.A.N. 3538  
*[Signature]*  
SEP 23 2015

**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
COMP-ANL\W08-35FFPG









**OUT-SWING WOOD PATIO DOOR (N.I.)**  
**F.P.G. WHOLESALE INC.**  
7190 CORAL WAY  
MIAMI, FLORIDA 33155  
TEL. (305) 266-2296 FAX (305) 261-6540

revisions:		no	date	by	description
A	05.16.08			REV. PER BCCO COMMENTS	
B	04.27.12			NO CHANGE THIS SHEET	
C	05.29.15			UPDATED TO 2014 FBC	
D	09.16.15			REV. PER RER COMMENTS	

date: 04-04-08  
scale: 3/8" = 1"  
dr. by: HAMID  
chk. by:

drawing no.  
**W08-35**

sheet 6 of 8

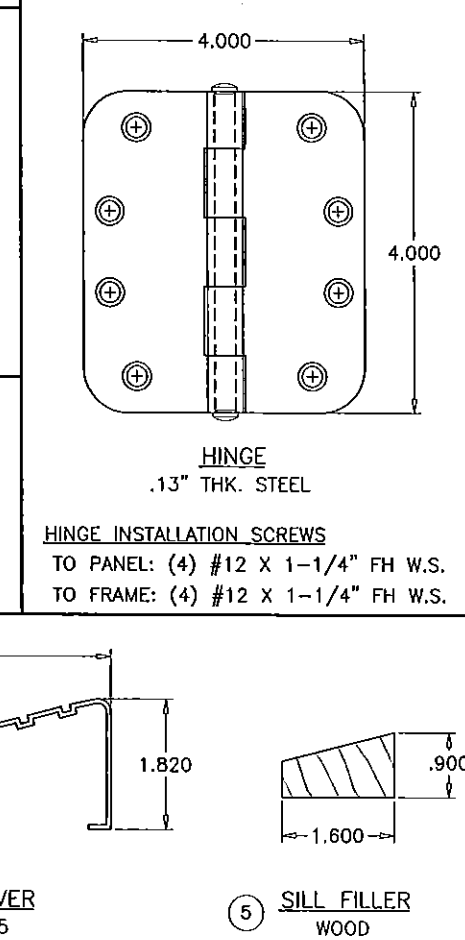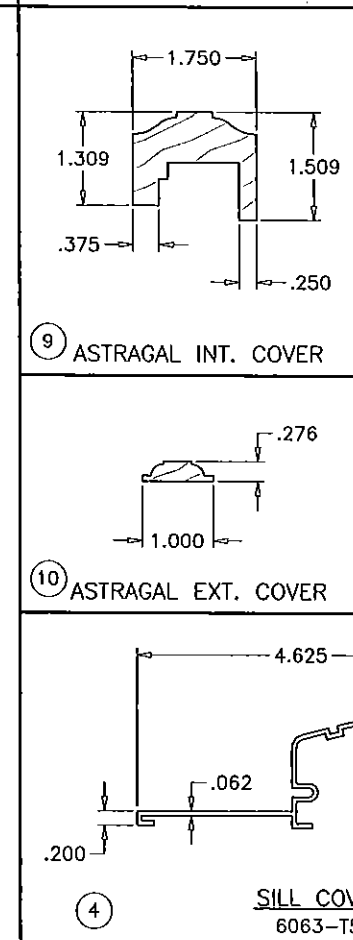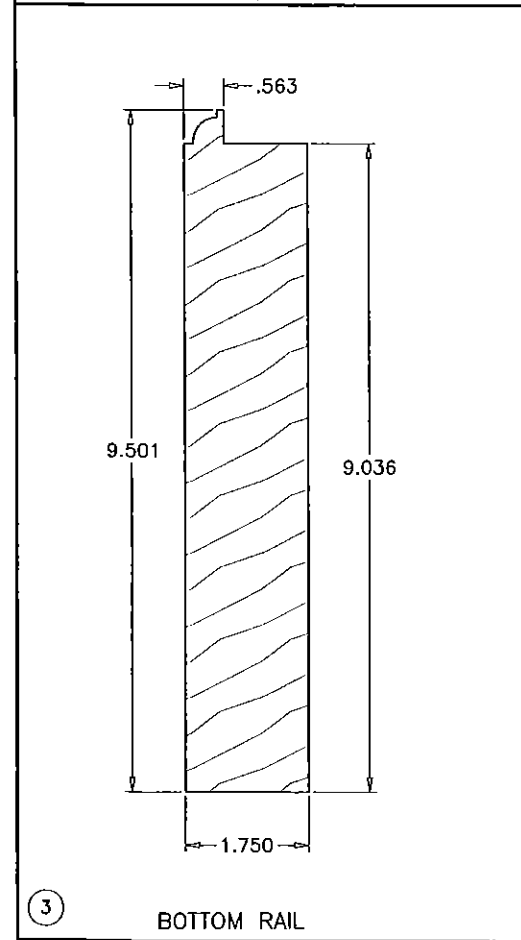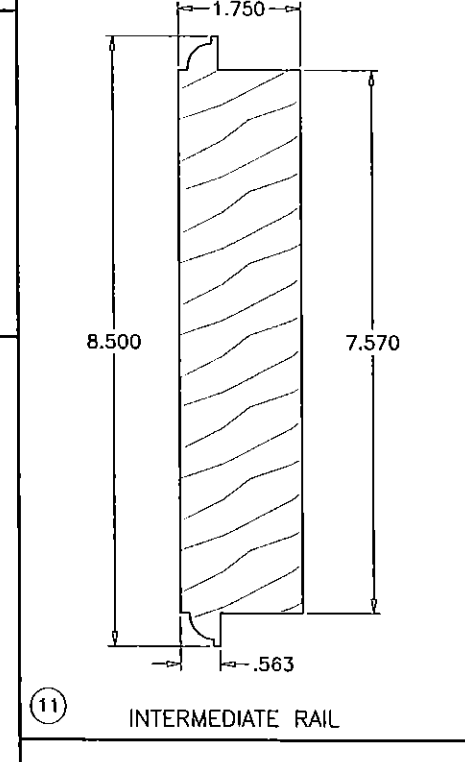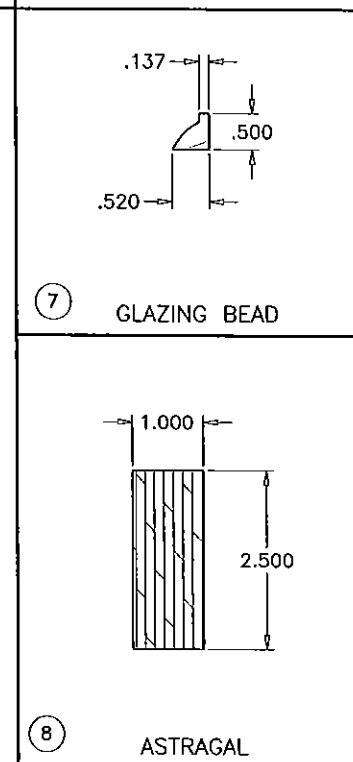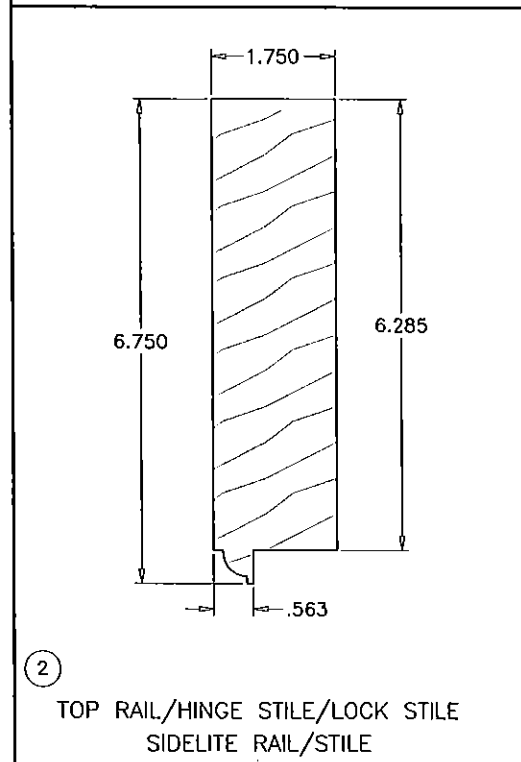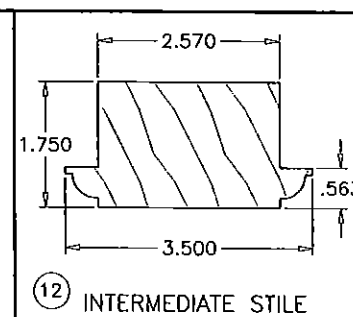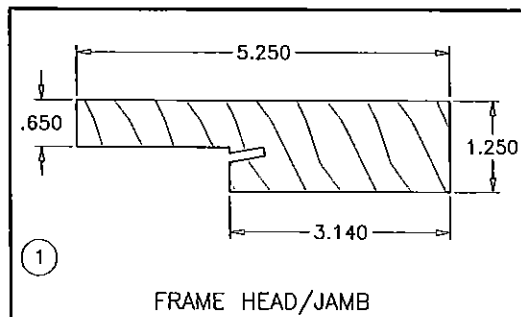

ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	-	3/ DOOR	FRAME HEAD/JAMB	WOOD	-
2	-	AS REQD.	TOP RAIL/HINGE & LOCK STILE/SIDELITE STILE	WOOD	-
3	-	1/ LEAF	BOTTOM RAIL	WOOD	-
4	-	1	SILL COVER	ALUMINUM	-
5	-	1	SILL FILLER	WOOD	-
6	-	1	FRAME SILL	WOOD	-
7	-	AS REQD.	GLAZING BEAD	WOOD	-
8	-	1	ASTRAGAL	PLYWOOD	AB MARINE GRADE 13 PLY
9	-	1	ASTRAGAL INTERIOR COVER	WOOD	-
10	-	-	ASTRAGAL EXTERIOR COVER	WOOD	-
11	-	AS REQD.	INTERMEDIATE RAIL	WOOD	-
12	-	AS REQD.	INTERMEDIATE STILE	WOOD	-
13	-	4/ LEAF	HINGE	STEEL	-
14	#10 X 3"	3/ CORNER	FRAME ASSEMBLY SCREWS FLAT HEAD	-	-
15	QEBD650	AS REQD.	FRAME W'STRIPPING, FOAM TIP	PVC	Q-LON

**WOOD OPTIONS**  
 1- SOUTHERN CHERRY  
 2- ANDEAN WALNUT  
 3- TROPICAL WALNUT  
 4- WHITE OAK  
 5- YESQUERO

SPECIFIC GRAVITY = 0.50 MIN. (E=1,400,000)  
 GRADE = 2 MIN.  
 MOISTURE CONTENT = 12% MAX.

#### SEALANT:

FRAME & PANEL CORNERS SEALED WITH NATIONAL CASEIN WUP 4379 ADHESIVE.

**HINGES:** 4" X 4" X .130" THK. HINGE  
 4 PER LEAF AT 9-3/4" FROM EACH END  
 AND 25-1/2" O.C. MAX.

#### LOCKS:




CONVENTIONAL LOCKSET WITH DEAD BOLT AT ACTIVE LEAF LOCK STILE  
 KEY OPERATED ON EXTERIOR AND THUMB TURN ON INTERIOR  
 PASSAGE LOCK AT 36" FROM BOTTOM,  
 DEAD BOLT AT 42" FROM BOTTOM

OPTION 1 = EMTEK CORTINA KEYED ENTRY DOOR LEVERSET  
 OPTION 2 = KWIKSET POLO KEYED ENTRY DOOR KNOBSET  
 OPTION 3 = BALDWIN KEYED ENTRY DOOR LEVERSET

MANUALLY OPERATED SURFACE BOLTS BY 'DELTANA' AT TOP AND  
 BOTTOM OF ACTIVE LEAF.  
 (MUST BE ENGAGED DURING PERIODS OF HURRICANE WARNING)

MANUALLY OPERATED CONCEALED FLUSH BOLTS AT TOP & BOTTOM  
 OF INACTIVE LEAF.

PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No. 15-0615.05  
 Expiration Date 06/30/2018  
 By *Manuel J. Lopez*  
 Miami Dade Product Control

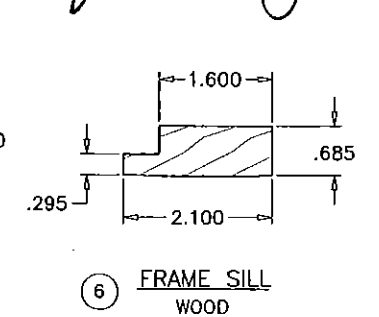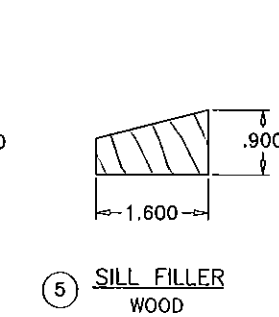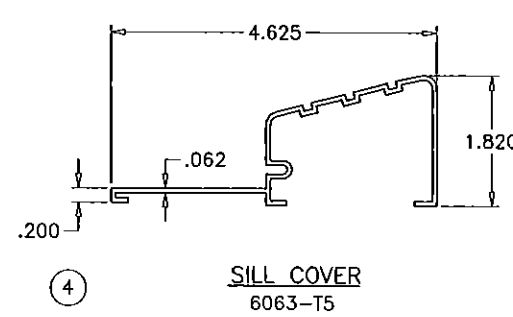

Engr: JAVAD AHMAD  
 CIVIL  
 FLA. PE # 70592  
 C.A.N. 3538

SEP 23 2015

**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 1235 S.W. 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANL\W08-35FFG


**OUT-SWING WOOD PATIO DOOR (N.I.)**  
**F.P.G. WHOLESALE INC.**  
 7190 CORAL WAY  
 MIAMI, FLORIDA 33155  
 TEL. (305) 266-2296 FAX (305) 261-6540

no	date	by	description
A	05.16.08	REV. PER BCCO COMMENTS	
B	04.27.12	UPDATED TO 2010 FBC	
C	05.29.15	NO CHANGE THIS SHEET	
D	09.16.15	REV. PER RER COMMENTS	


date: 04-04-08  
 scale: 3/8" = 1"  
 dr. by: HAMID  
 chk. by:

drawing no.  
**W08-35**


sheet 7 of 8

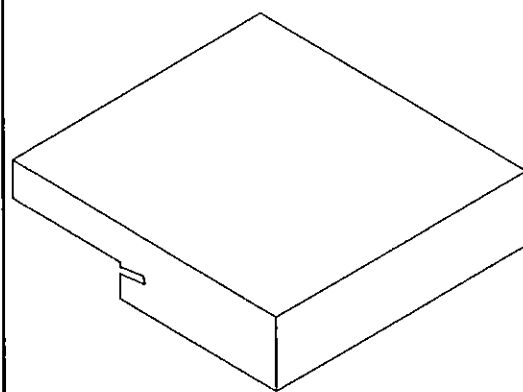


FRAME TOP CORNER

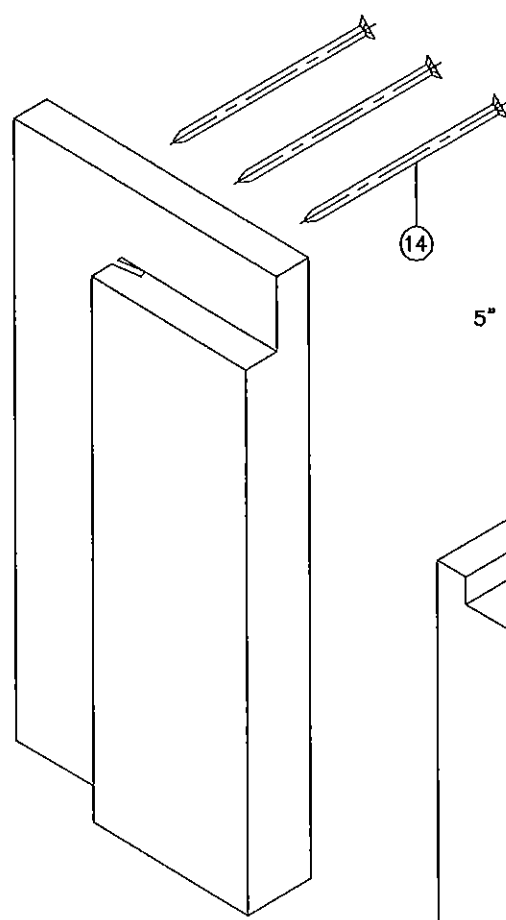


INTERMEDIATE CORNER

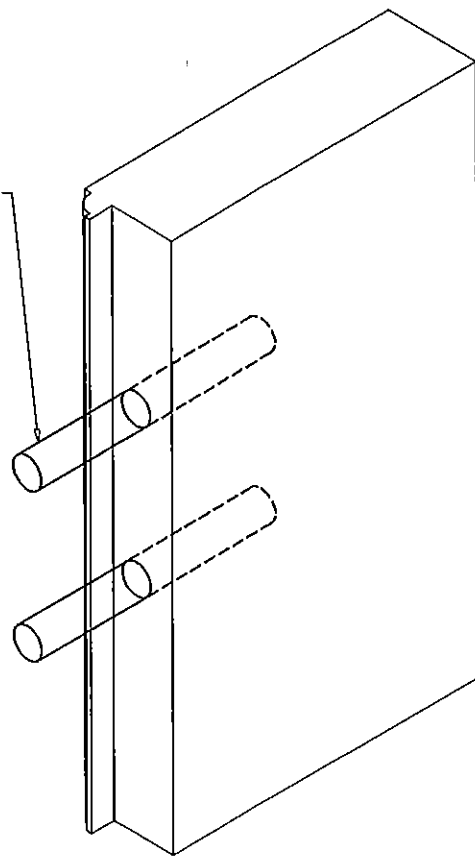


PANEL TOP CORNER

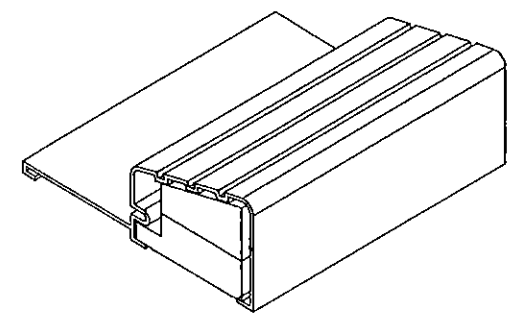

FRAME BOTTOM CORNER

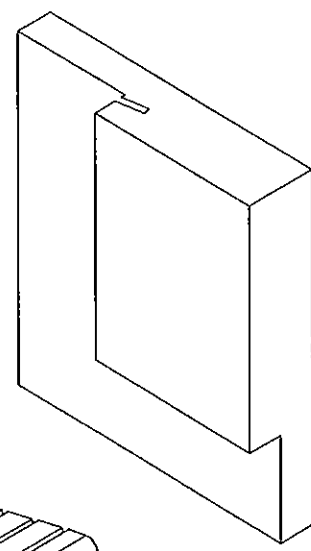

PANEL BOTTOM CORNER

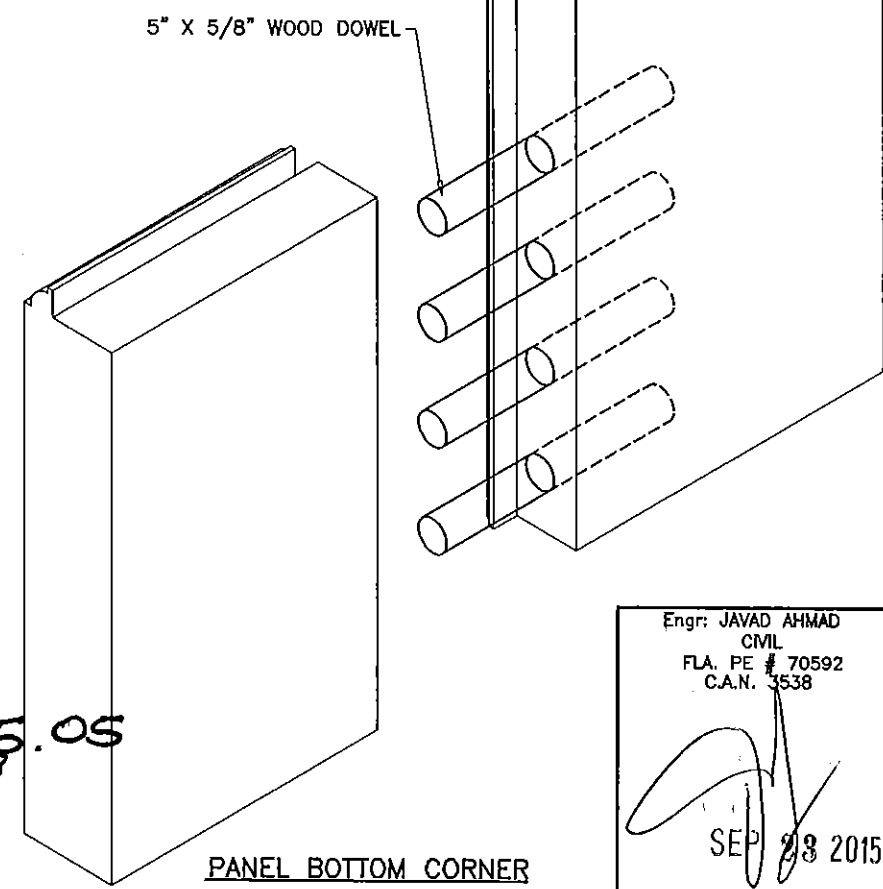

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 15-0615.05  
Expiration Date 06/29/2018  
By *Manuel M...*  
Miami Dade Product Control

Engr: JAVAD AHMAD  
CML  
FLA. PE # 70592  
C.A.N. 3538  
*[Signature]*  
SEP 23 2015

**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL (305) 264-8100 FAX (305) 262-6978  
COMP-ANL\W08-35FFPG

OUT-SWING WOOD PATIO DOOR (N.I.)

**F.P.G. WHOLESALE INC.**  
7190 CORAL WAY  
MIAMI, FLORIDA 33155  
TEL (305) 266-2296 FAX (305) 261-6540

no	date	by	description
A	05.16.08		NO CHANGE THIS SHEET
B	04.27.12		NO CHANGE THIS SHEET
C	05.29.15		NO CHANGE THIS SHEET
D	09.16.15		REV. PER RER COMMENTS

date: 04-04-08  
scale: 3/8" = 1"  
dr. by: HAMID  
chk. by:

drawing no.  
**W08-35**

sheet 8 of 8